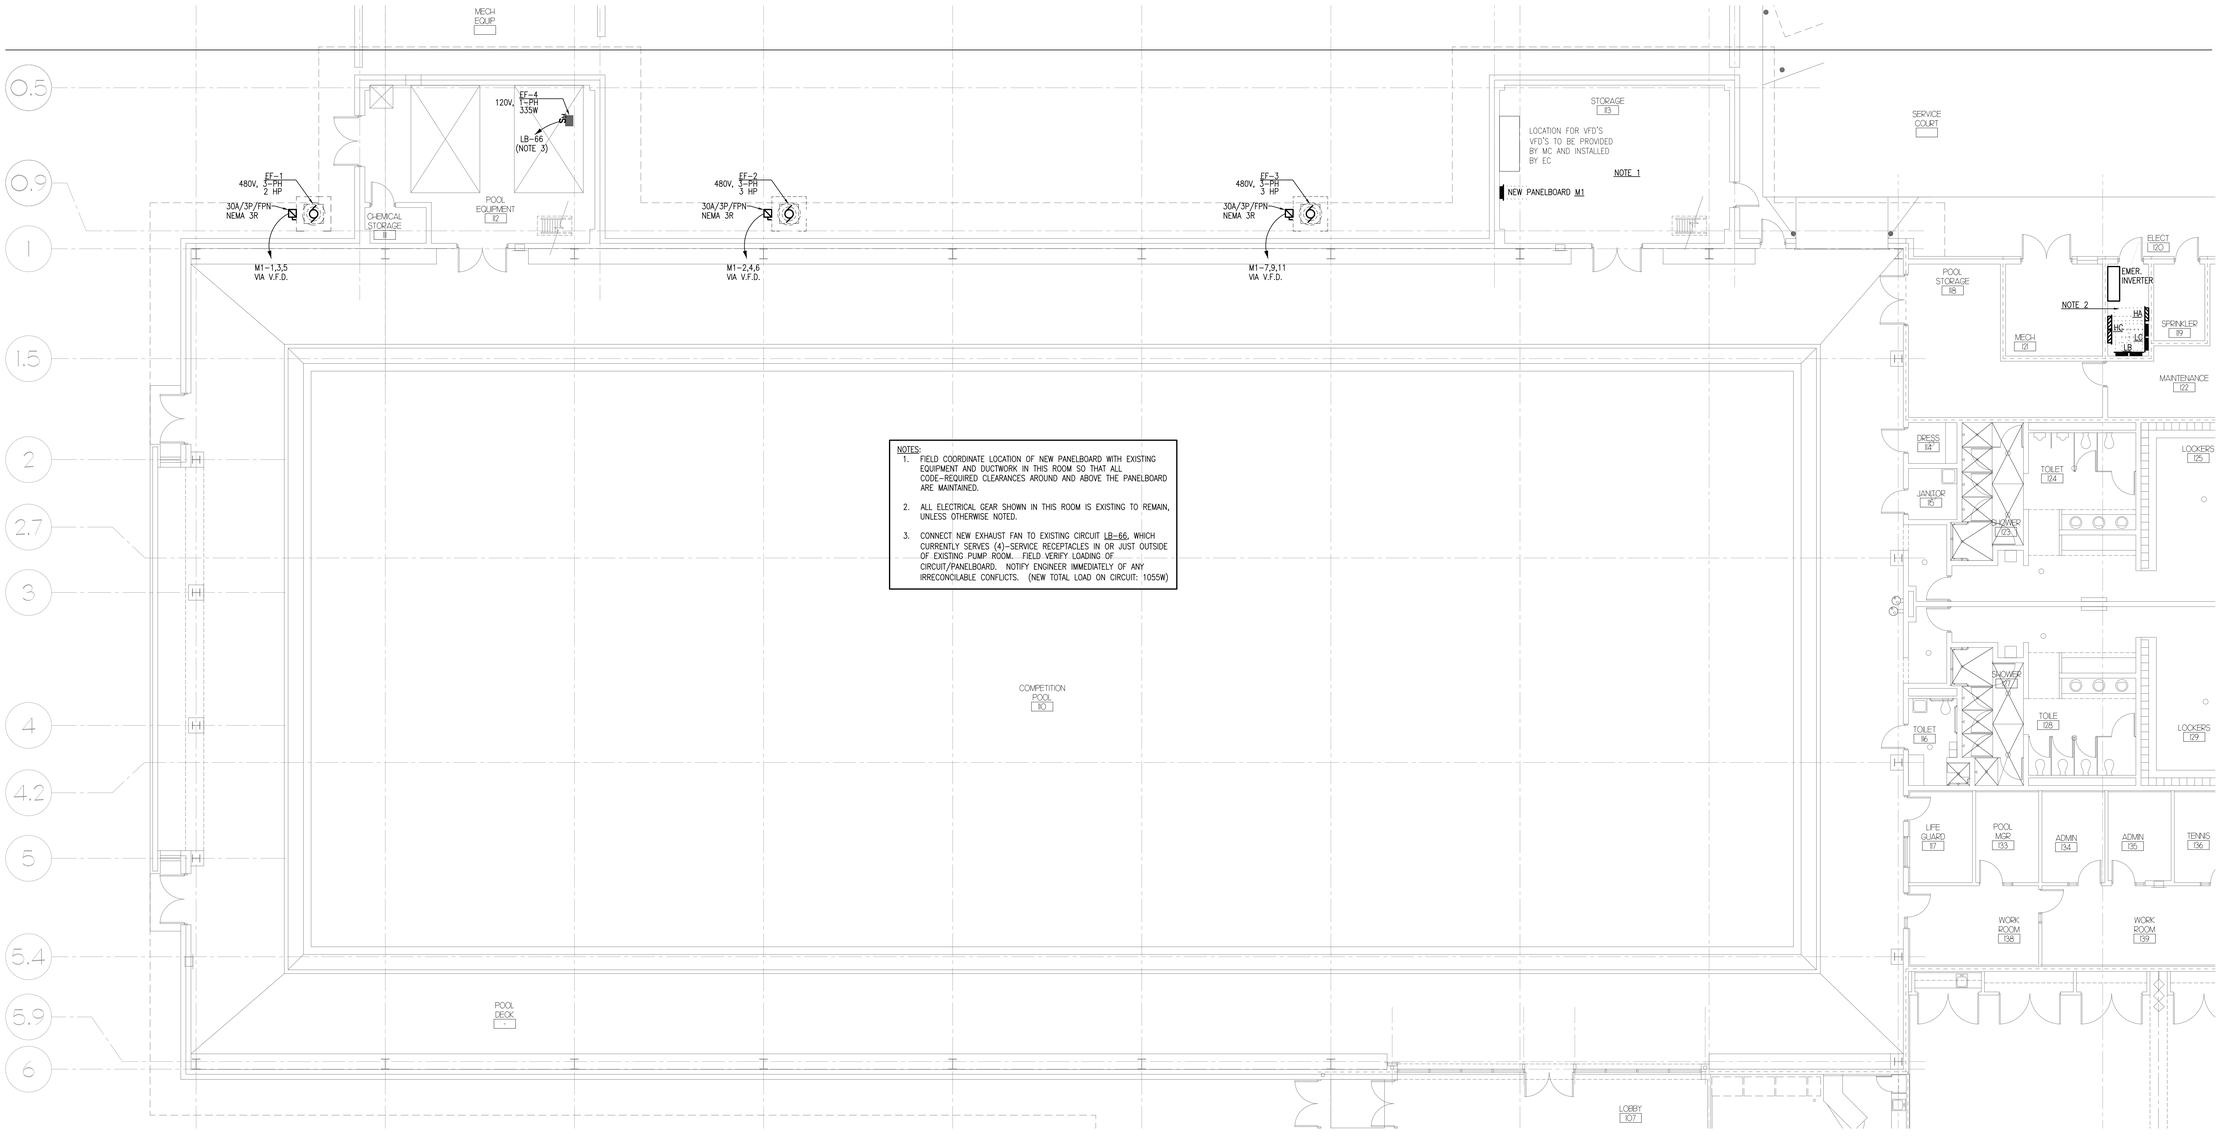

NOTES:
1. FIELD COORDINATE LOCATION OF NEW PANELBOARD WITH EXISTING EQUIPMENT AND DUCTWORK IN THIS ROOM SO THAT ALL CODE-REQUIRED CLEARANCES AROUND AND ABOVE THE PANELBOARD ARE MAINTAINED.
2. ALL ELECTRICAL GEAR SHOWN IN THIS ROOM IS EXISTING TO REMAIN, UNLESS OTHERWISE NOTED.
3. CONNECT NEW EXHAUST FAN TO EXISTING CIRCUIT LB-66, WHICH CURRENTLY SERVES (4)-SERVICE RECEPTACLES IN OR JUST OUTSIDE OF EXISTING PUMP ROOM. FIELD VERIFY LOADING OF CIRCUIT/PANELBOARD. NOTIFY ENGINEER IMMEDIATELY OF ANY IRRECONCILABLE CONFLICTS. (NEW TOTAL LOAD ON CIRCUIT: 1055W)

1 / E3 **FLOOR PLAN - ELECTRICAL**
SCALE: 1/8" = 1'-0"

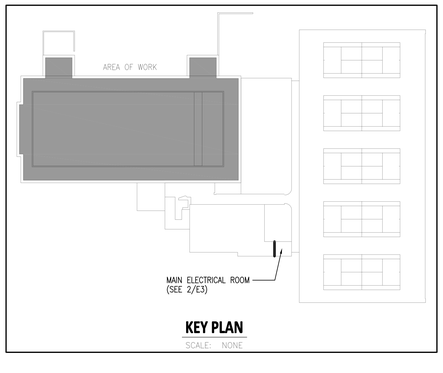

KEY PLAN
SCALE: NONE



2 / E3 **FLOOR PLAN - MAIN ELECTRICAL ROOM**
SCALE: 1/8" = 1'-0"

Timothy A. Payne, PE
212 N. McDowell St, Suite 204
Charlotte, NC 28204
(P) 704.334.7363 (F) 704.347.0093
www.shultzeg.com
SEG - 15-xxx

WILLIAMS COUNTY INDOOR SPORTS COMPLEX
INDOOR 50-METER SWIMMING POOL
PADDOCK EVACUATOR FAN SYSTEM

ENGINEER'S SEAL

06/24/15

REV.	DATE	DESCRIPTION

DATE: 06/22/2015

PROJECT NO.: 15-055.00

TITLE: FLOOR PLAN ELECTRICAL

DRAWING NO. E3